

# MANDÍK CPV48-H



MANDÍK®

# MANDÍK CPV48-H






Nominal airflow:	4800 [m³/h]
Input power:	3~400 V / 50 Hz – water heating / condenser 3~400 V / 50 Hz – electric heating
The maximum operating current:	5,5 [A] – water heating / condenser 43.2 / 49.2 / 57.2 [A]* – electric heating
External surface finish:	RAL 9010 + RAL 5012 (standard version)
Internal surface finish:	RAL 9010 (standard version)
Weight:	350 [kg]
Sheathing insulation:	mineral wool, 65 kg/m³

\* power grades of electric heating

## Levels of acoustic performance:

Frequency band	LwA [dB]	63	125	250	500	1000	2000	4000	8000	[Hz]
Suction inlet	76.9	67.3	72.42	78.54	74.46	69.36	69.36	65.28	62.22	[dB]
Discharge inlet	83.7	72.4	74.46	81.6	79.56	79.56	76.5	71.4	67.32	[dB]
Suction outlet	76.4	67.3	74.46	78.54	74.46	68.34	68.34	64.26	61.2	[dB]
Discharge outlet	82.8	71.4	75.48	81.6	78.54	78.54	75.48	70.38	67.32	[dB]
Noise to the ambient	62.5		48.2	59.7	55.2	55.1	50.3	42	31	[dB]

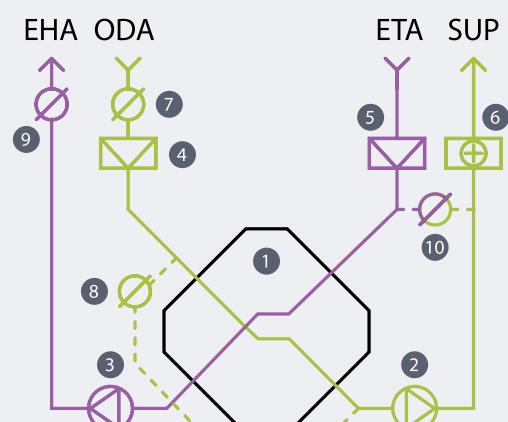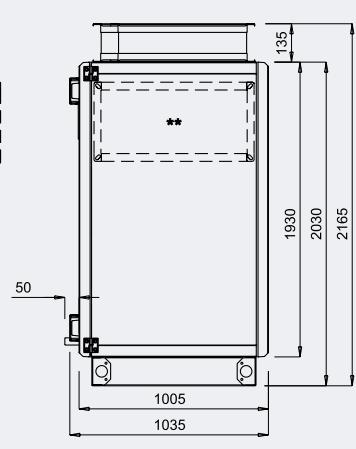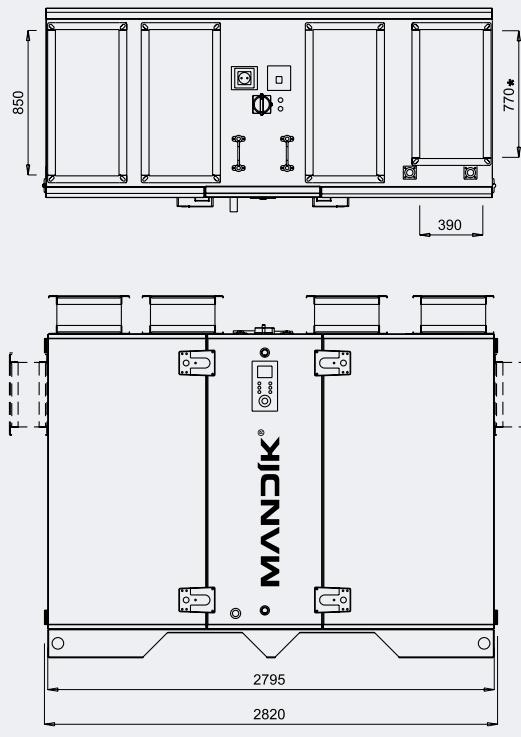

ODA – fresh air  
SUP – outlet air EHA

ETA – inlet air  
EHA – waste air

- ① Plate recuperator
- ② Inlet fan
- ③ Outlet fan
- ④ Inlet filter
- ⑤ Outlet filter
- ⑥ Heater
- ⑦ Inlet damper
- ⑧ By-pass damper
- ⑨ Outlet damper
- ⑩ Mixing damper

\* for water heating / condenser; for electric heating = 850 mm

\*\* possible SUP/EHA outlets to side, size 850 × 390 mm

## Filtration

Přívod:	F7, compact, 525 × 915 × 96 mm
Odvod:	M5, compact, 525 × 915 × 96 mm

## Recuperation

Cross-flow heat exchanger (plate type, counter-flow)

Temperature efficiency in the winter:	74.4 [%] *
Temperature efficiency in the summer:	77.7 [%] **

\* in the conditions according to EN 308, ODA = 5 °C / 20 % rH,  
ETA = 25 °C / 20 % rH

\*\* in the conditions according to ODA = 32 °C / 45 % rH,  
ETA = 25 °C / 50 % rH

## Mixing

Possible installation of the damper for mixing the outlet air with the fresh air, including possibility to set up the minimum and maximum rate of mixing.

## Heating

### Water heating CPV48

Power	STANDARD				INCREASED				HIGH			
	Q <sub>t'</sub> t <sub>sup</sub>	24.8 kW, t <sub>sup</sub> = +22 °C			29.1 kW, t <sub>sup</sub> = +25 °C			33.9 kW, t <sub>sup</sub> = +28 °C				
medium – water	80/60 °C	70/50 °C	50/40 °C	45/35 °C	80/60 °C	70/50 °C	50/40 °C	45/35 °C	80/60 °C	70/50 °C	50/40 °C	45/35 °C
Number of rows	2	2	2	3	2	2	3	3	2	2	3	4
flow of medium [m <sup>3</sup> /h]	1.09	1.09	2.16	2.15	1.28	1.27	2.53	2.52	1.49	1.49	2.95	2.95
pressure loss of medium [kPa]	6.4	6.6	24.1	6.4	8.6	8.8	8.5	8.5	11.4	11.6	17	8.4
Connections	DN 20	DN 20	DN 20	DN 25	DN 20	DN 20	DN 25	DN 25	DN 20	DN 20	DN 20	DN 25

material of the tube / lamella Cu/Al

### Electric heating CPV48

Power	STANDARD			INCREASED			HIGH				
	Q <sub>t'</sub> t <sub>sup</sub>	24.8 kW, t <sub>sup</sub> = +22 °C		29.1 kW, t <sub>sup</sub> = +25 °C			33.9 kW, t <sub>sup</sub> = +28 °C				
Heating spirals	13× 2.0 kW			15× 2.0 kW			17× 2.0 kW				
Current [A]	38			44			52				

The heater is equipped with operating (+50 °C) and emergency (+80 °C) thermostat

### Condenser CPV48


Power	STANDARD			INCREASED			HIGH		
	Q <sub>t'</sub> t <sub>sup</sub>	24.8 kW, t <sub>sup</sub> = +22 °C		29.1 kW, t <sub>sup</sub> = +25 °C			33.9 kW, t <sub>sup</sub> = +28 °C		
Cooling medium	R410A	R407C		R410A	R407C		R410A	R407C	
Number of rows	3	3		3	3		4	4	
flow of medium [m <sup>3</sup> /h]	4.2	6.4		4.2	6.5		5.5	8.4	
Volume [l]	4	4		4	4		5.3	5.3	
Connections in/out	1 × 28 / 1 × 22	1 × 28 / 1 × 22		1 × 28 / 1 × 22	1 × 28 / 1 × 22		1 × 28 / 1 × 22	1 × 28 / 1 × 22	

With condensing temperature = 50 °C, one-way direction – heating only, one-circuit, material of the tube / lamella Cu/Al

## EC fan (inlet / outlet)


Input power:	1.574/1.3 [kW]*
Voltage:	400 [V]
Current:	2.6/2.39 [A]
RPM	2117/2052 [RPM]

\* in case of external pressure loss 250 Pa, air performance 4800 m<sup>3</sup>/h, water heating – standard performance

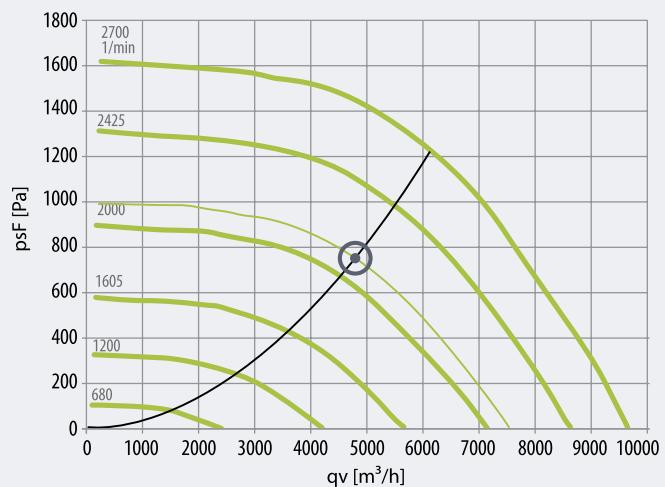


# MANDÍK CPV48-H

## Maximum external pressure CPV48 standard – inlet part

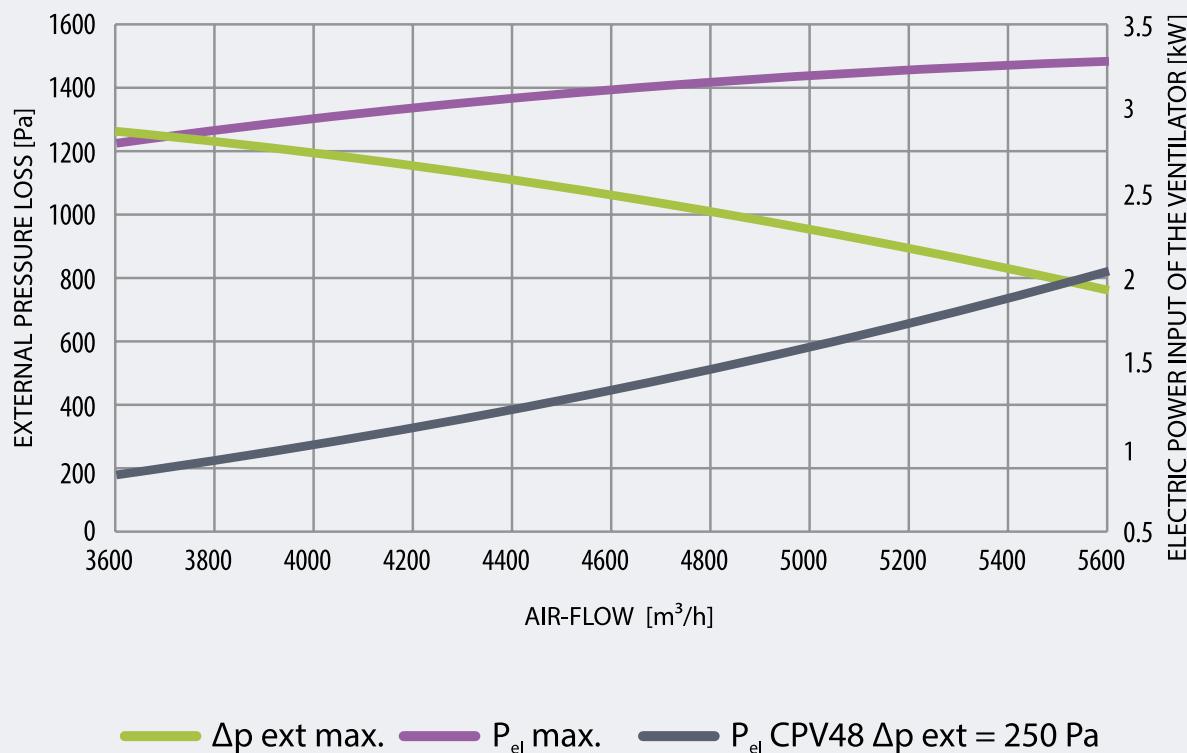

## Efficiency of the heat exchanger ZZT

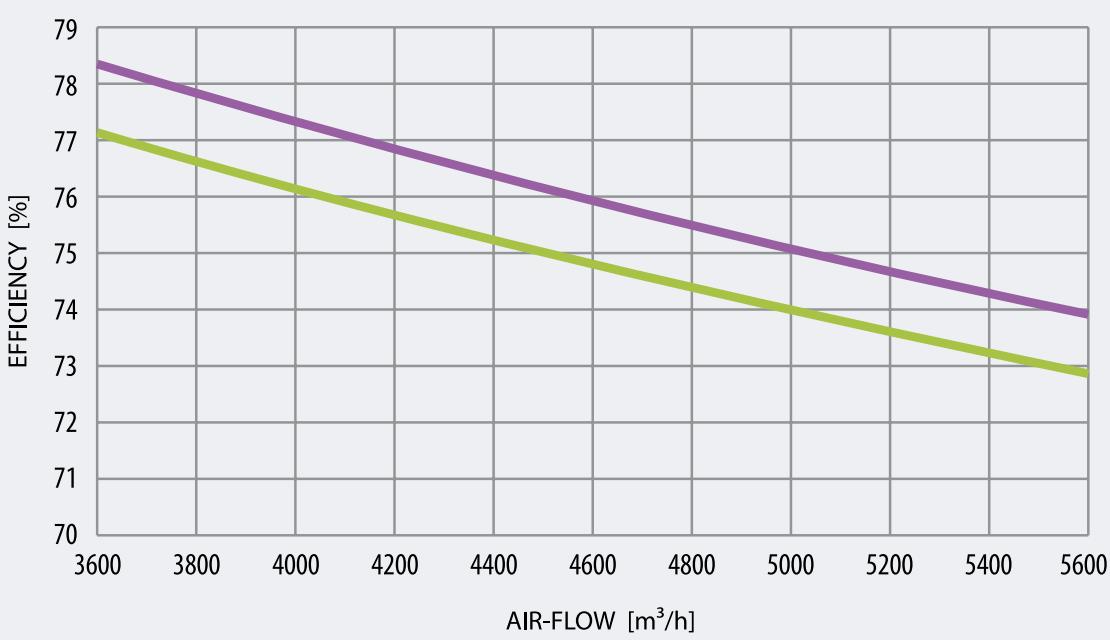

EN308      With condensation at -5 °C / 80% rH, +20 °C / 40% rH

# STANDARD EQUIPMENT

## SURFACE TREATMENT:

- Outer surface and end element – powder coating
- Inner surface and in-building – powder coating

## COMPONENTS:


- Counter-flow heat exchanger (aluminium)
- by-pass recuperation
- EC fans (free impellers) – inlet / outlet
- filtration – F7 inlet, M5 outlet
- lamella hot-water heater / electric heater / condenser
- suction damper of fresh air
- discharge damper of waste air
- by-pass damper
- mixing damper / circulation
- buffering inserts, square shape, 2x suction, 2x discharge
- base frame of the unit

## CONTROL, ELECTRO EQUIPMENT:

- switchboard, in-built
- PLC, display (possible parametrization), web interface (possible parametrization)
- servo-drives of dampers – inlet / outlet / by-pass / mixing
- switching the pressure difference of filters – inlet / outlet
- temperature sensors – fresh / behind recuperation / inlet / outlet / recuperation frost
- capillary thermostat (anti-frost) of the hot-water heater
- control of performance of electric heat (PWM, SSR)
- service switch
- socket 230 V
- socket RJ45
- probes to measure pressure difference of the ventilator – inlet / outlet

# ACCESSORIES

## MIXING JUNCTIONS:

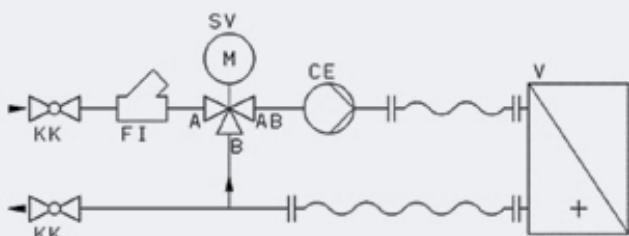


KK – closing ball valve  
 FI – filter  
 SV – regulation ball valve with actuator  
 CE – pump  
 V – water exchanger

- Mixing junction of the hot-water heater CPV48,  $Q_t = 24.8 \text{ kW}$   
 Heat-bearing medium: water 80/60 °C USJR 25-60-2.5-SR Rp 3/4" Rp 3/4", 1.28 m³/h  
 Heat-bearing medium: water 70/50 °C USJR 25-60-2.5-SR Rp 3/4" Rp 3/4", 1.28 m³/h  
 Heat-bearing medium: water 50/40 °C USJR 25-60-6.3-SR Rp 1" Rp 1", 2.22 m³/h  
 Heat-bearing medium: water 45/35 °C USJR 25-60-6.3-SR Rp 1" Rp 1", 2.22 m³/h
- Mixing junction of the hot-water heater CPV48,  $Q_t = 29.1 \text{ kW}$   
 Heat-bearing medium: water 80/60 °C USJR 25-60-2.5-SR Rp 3/4" Rp 3/4", 1.28 m³/h  
 Heat-bearing medium: water 70/50 °C USJR 25-60-2.5-SR Rp 3/4" Rp 3/4", 1.28 m³/h  
 Heat-bearing medium: water 50/40 °C USJR 25-100-6.3-SR Rp 1" Rp 1", 3.38 m³/h  
 Heat-bearing medium: water 45/35 °C USJR 25-100-6.3-SR Rp 1" Rp 1", 3.38 m³/h
- Mixing junction of the hot-water heater CPV48,  $Q_t = 33.9 \text{ kW}$   
 Heat-bearing medium: water 80/60 °C USJR 25-60-4.0-SR Rp 3/4" Rp 3/4", 1.68 m³/h  
 Heat-bearing medium: water 70/50 °C USJR 25-60-4.0-SR Rp 3/4" Rp 3/4", 1.68 m³/h  
 Heat-bearing medium: water 50/40 °C USJR 25-100-6.3-SR Rp 1" Rp 1", 3.38 m³/h  
 Heat-bearing medium: water 45/35 °C USJR 25-100-6.3-SR Rp 1" Rp 1", 3.38 m³/h

# MANDÍK CPV48-H

## 3-WAY VALVES

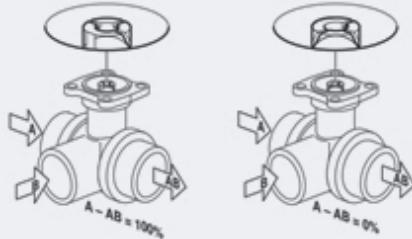

### ■ 3-way valve of the water heater CPV48, $Q_t = 24.8 \text{ kW}$

Heat-bearing medium: water 80/60 °C

BELIMO, R3015-1P6-S1, kvs = 1.6 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 70/50 °C

BELIMO, R3015-1P6-S1, kvs = 1.6 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 50/40 °C

BELIMO, R3015-2P5-S1, kvs = 2.5 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 45/35 °C

BELIMO, R3015-2P5-S1, kvs = 2.5 m<sup>3</sup>/h, DN = 15.5 Nm

### ■ 3-way valve of the water heater CPV48, $Q_t = 29.1 \text{ kW}$

Heat-bearing medium: water 80/60 °C

BELIMO, R3015-1P6-S1, kvs = 1.6 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 70/50 °C

BELIMO, R3015-1P6-S1, kvs = 1.6 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 50/40 °C

BELIMO, R3015-4P-S1, kvs = 4.0 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 45/35 °C

BELIMO, R3015-4P-S1, kvs = 4.0 m<sup>3</sup>/h, DN = 15.5 Nm

### ■ 3-way valve of the water heater CPV48, $Q_t = 33.9 \text{ kW}$

Heat-bearing medium: water 80/60 °C

BELIMO, R3015-2P5-S1, kvs = 2.5 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 70/50 °C

BELIMO, R3015-2P5-S1, kvs = 2.5 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 50/40 °C

BELIMO, R3015-4P-S1, kvs = 4.0 m<sup>3</sup>/h, DN = 15.5 Nm

Heat-bearing medium: water 45/35 °C

BELIMO, R3015-4P-S1, kvs = 4.0 m<sup>3</sup>/h, DN = 15.5 Nm

## ACTUATORS FOR 3-WAY VALVES



BELIMO LR24A-SR, AC/DC 24 V, 0–10 V, 5 Nm

## CO<sub>2</sub> SENSOR



PROTRONIX AS CO2-DG, 0–10 V, 400–2000 ppm

## REMOTE CONTROL



DIGICONTROL ROOM4D

*Temperature adjustment, control of rotational speed  
of the ventilator, integrated temperature sensor, 2x DO (0 V / 24 V DC)  
CAN-Bus, DALI, KNX, Modbus*

## VISUALIZATION



License for visualization Webserver

*Overall graphic view of the unit with the current condition of action elements  
and sensors of control system (measuring and regulation)*

## ROUTER




TP-LINK TL-WR841ND

*WiFi router 802.11b/g/n až 300 Mbps, 1x WAN, 4x LAN*

## SIPHON FOR CONDENSATE OUTLET



HL136NGG, DN32, vacual with ball



# ORDER CODE FOR THE COMPACT UNITS OF CPV SERIES

Type of unit	Size of unit	Heating	Cooling	Filtration	Equipment of damper	Outlets
CPV	-	12	-	XXX	-	XXX
<b>1<sup>st</sup> sign C</b> = compact	<b>1<sup>st</sup> - 2<sup>nd</sup> sign</b> = * 100 = Vn [m <sup>3</sup> /h] 12 = 1200 m <sup>3</sup> /h 24 = 2400 m <sup>3</sup> /h 36 = 3600 m <sup>3</sup> /h 48 = 4800 m <sup>3</sup> /h 60 = 6000 m <sup>3</sup> /h	<b>1<sup>st</sup> sign</b> = type of heating 1 = water heater 2 = condenser 3 = electric heater	<b>1<sup>st</sup> sign</b> = none	<b>1<sup>st</sup> sign</b> = type of inlet filtration 1 = water 80/60 °C 2 = water 70/50 °C 3 = water 50/40 °C 4 = water 45/35 °C 5 = cooling agent R410A 6 = cooling agent R407C	<b>1<sup>st</sup> sign</b> = mixing damper 0 = mixing damper not installed 1 = mixing damper installed*	<b>1<sup>st</sup> sign</b> = right*
<b>2<sup>nd</sup> sign P</b> = plate recuperation					<b>2<sup>nd</sup> sign</b> = location of SUP and EHA outlets	<b>2<sup>nd</sup> sign</b> = location of SUP and EHA outlets
<b>3<sup>rd</sup> sign V</b> = vertical					<b>2<sup>nd</sup> sign</b> = top wall/ 2 = side walls	<b>2<sup>nd</sup> sign</b> = top wall/ 2 = side walls
					<b>3<sup>rd</sup> sign</b> = type of outlet filter 0 = no (electric heater) 1 = water 80/60 °C 2 = water 70/50 °C 3 = water 50/40 °C 4 = water 45/35 °C 5 = cooling agent R410A 6 = cooling agent R407C	<b>3<sup>rd</sup> sign</b> = type of outlet filter 0 = no (electric heater) 1 = water 80/60 °C 2 = water 70/50 °C 3 = water 50/40 °C 4 = water 45/35 °C 5 = cooling agent R410A 6 = cooling agent R407C
					<b>3<sup>rd</sup> sign</b> = frame with thickness 96 mm	<b>3<sup>rd</sup> sign</b> = frame with thickness 96 mm
					<b>4<sup>th</sup> sign</b> = type of outlet filter 1 = inlet damper installed*	<b>4<sup>th</sup> sign</b> = type of outlet filter 1 = inlet damper installed*
					<b>5<sup>th</sup> sign</b> = outlet damper 0 = outlet damper not installed 1 = outlet damper installed*	<b>5<sup>th</sup> sign</b> = outlet damper 0 = outlet damper not installed 1 = outlet damper installed*

**CPV48-121-XXX-3121-111-111**

4800 m<sup>3</sup>/h

Water heater, medium 80/60 °C, heat performance LOW (24.8 kW)

no

inlet = F7 frame with thickness 96 mm, outlet: M5 frame with thickness 96 mm

mixing: installed, inlet: installed, outlet: installed

to the right -> right version

on the top wall

rectangular shape

**Example of the unit:**

Nominal air flow:

4800 m<sup>3</sup>/h

In case of requirement for a version other than standard, this should be noted in the purchase order.

Note:

\* standard version Paint:

Painting is divided into 2 parts (as standard)

1) RAL colour of the unit (outer) + inner + in-building: RAL9010 (standard version)

2) RAL colour of the central panel + buffering inserts + base frame RAL9006 (standard version)

Optionally, the parts of the unit may be combined in various ways, such as the overall outer surface (sheathing, buffering inserts, base frame) in one colour; inner surface (sheathing, in-building) in another colour, etc.

**MANDÍK, a. s.**

Dobříšská 550

267 24 HOSTOMICE

Czech Republic

Phone: +420 311 706 706

Fax: +420 311 584 810

E-mail: [mandik@mandik.cz](mailto:mandik@mandik.cz)

[www.mandik.cz](http://www.mandik.cz)